


Confirmation Details for Cross Flow Rectangle Cooling Tower Infill Replacement

1. For correct offer, below information is necessary:

A. Infill Size confirmation: a\b\c\d

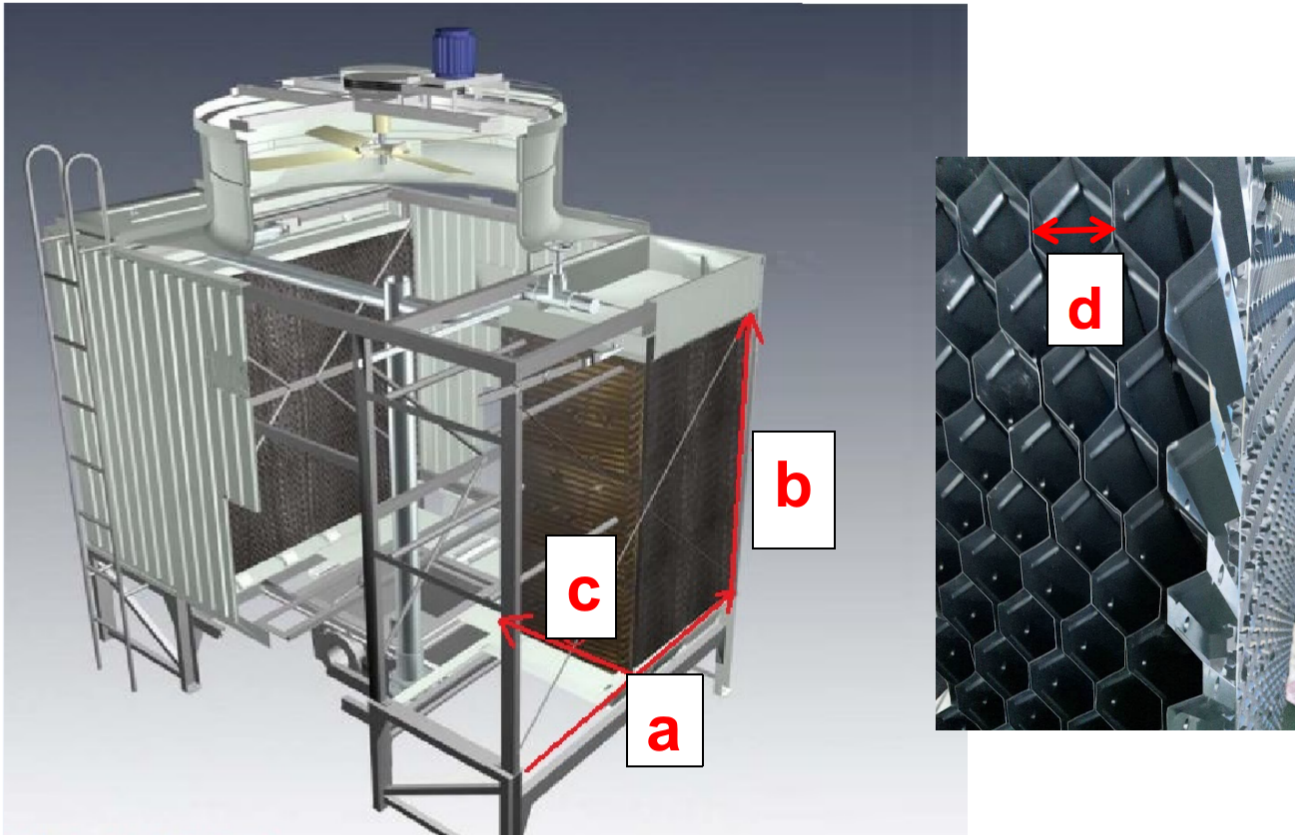

a direction (Air inlet length) = _____ mm

b direction (infill height) = _____ mm

b direction: number of layers = _____ layer/layers, height of each layer = _____ mm

c direction (infill width) = _____ mm d distance = _____ mm

B. Quantity of cooling towers and quantity of fans for each cooling tower.

C. Sheet thickness and Picture of the infill or Brand of the cooling tower

2. If no detailed information, below information is required for evaluating the quantity of the fills.

a. Cooling tower brand with tower model (nameplate is better)

b. Picture of the full cooling towers.